

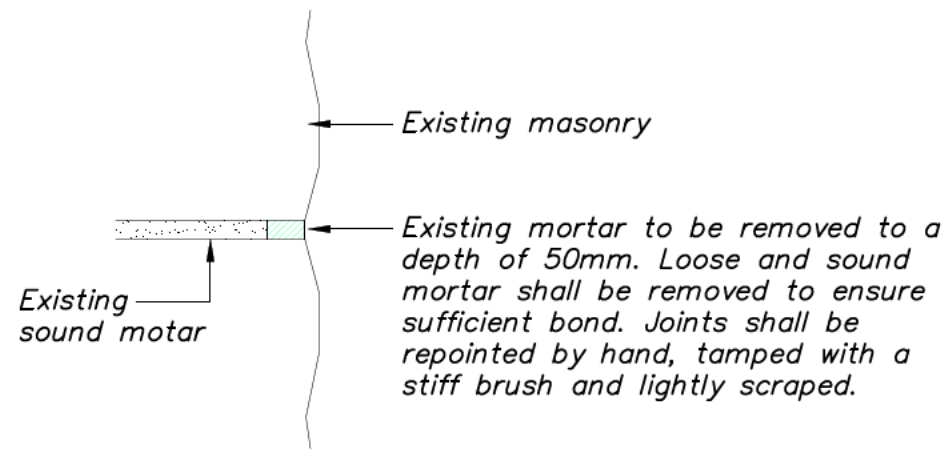
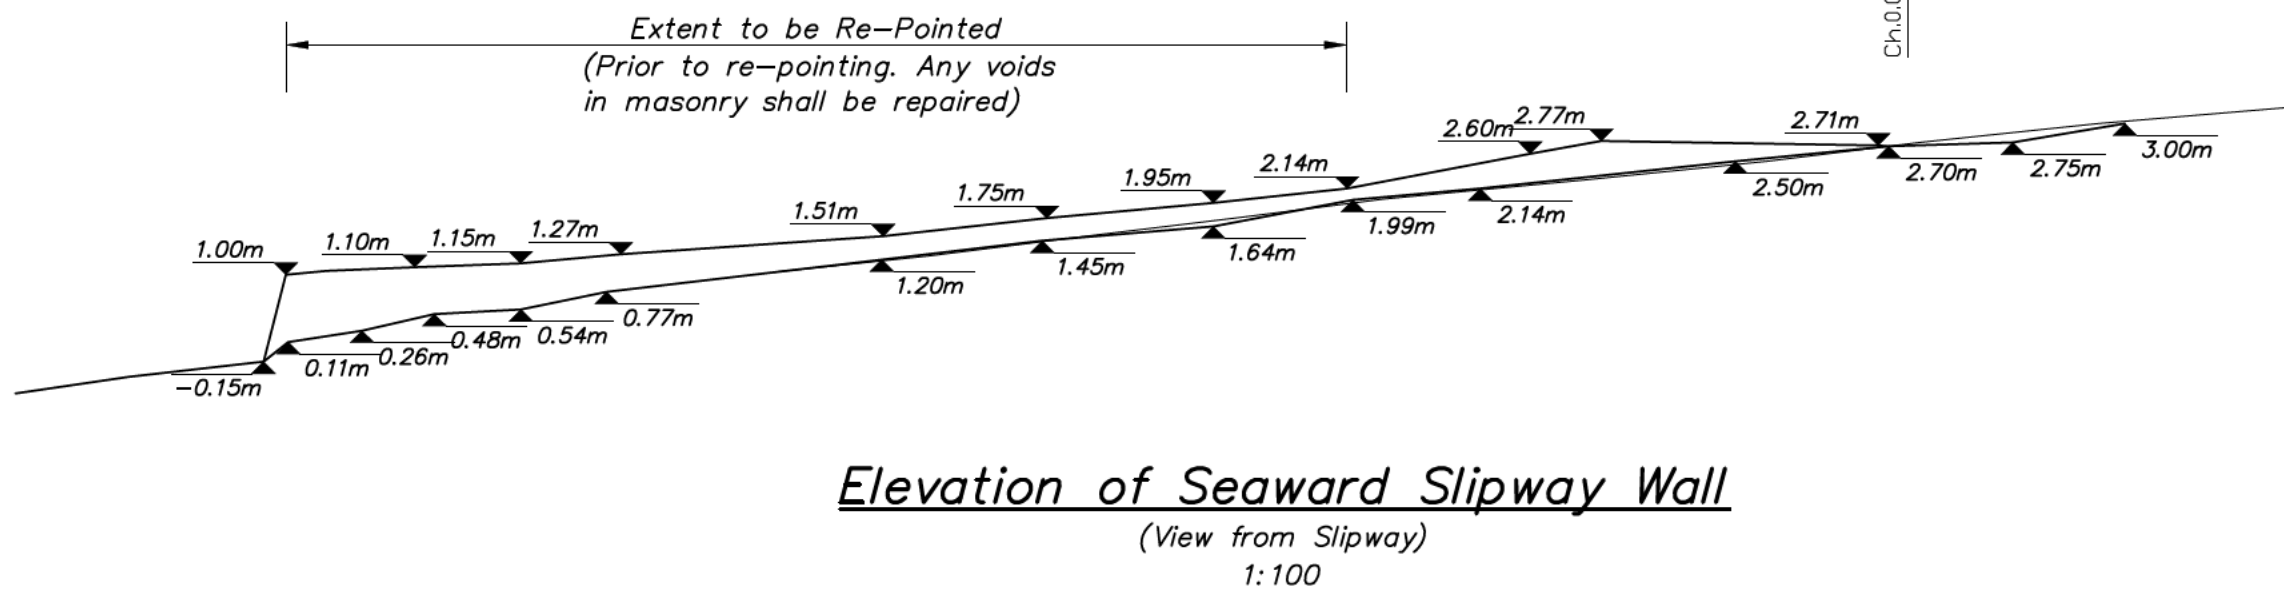


Rev.	Date	By	Check	Details	Appr.
P01	23/07/26	PDB	JW	First Issue	RH

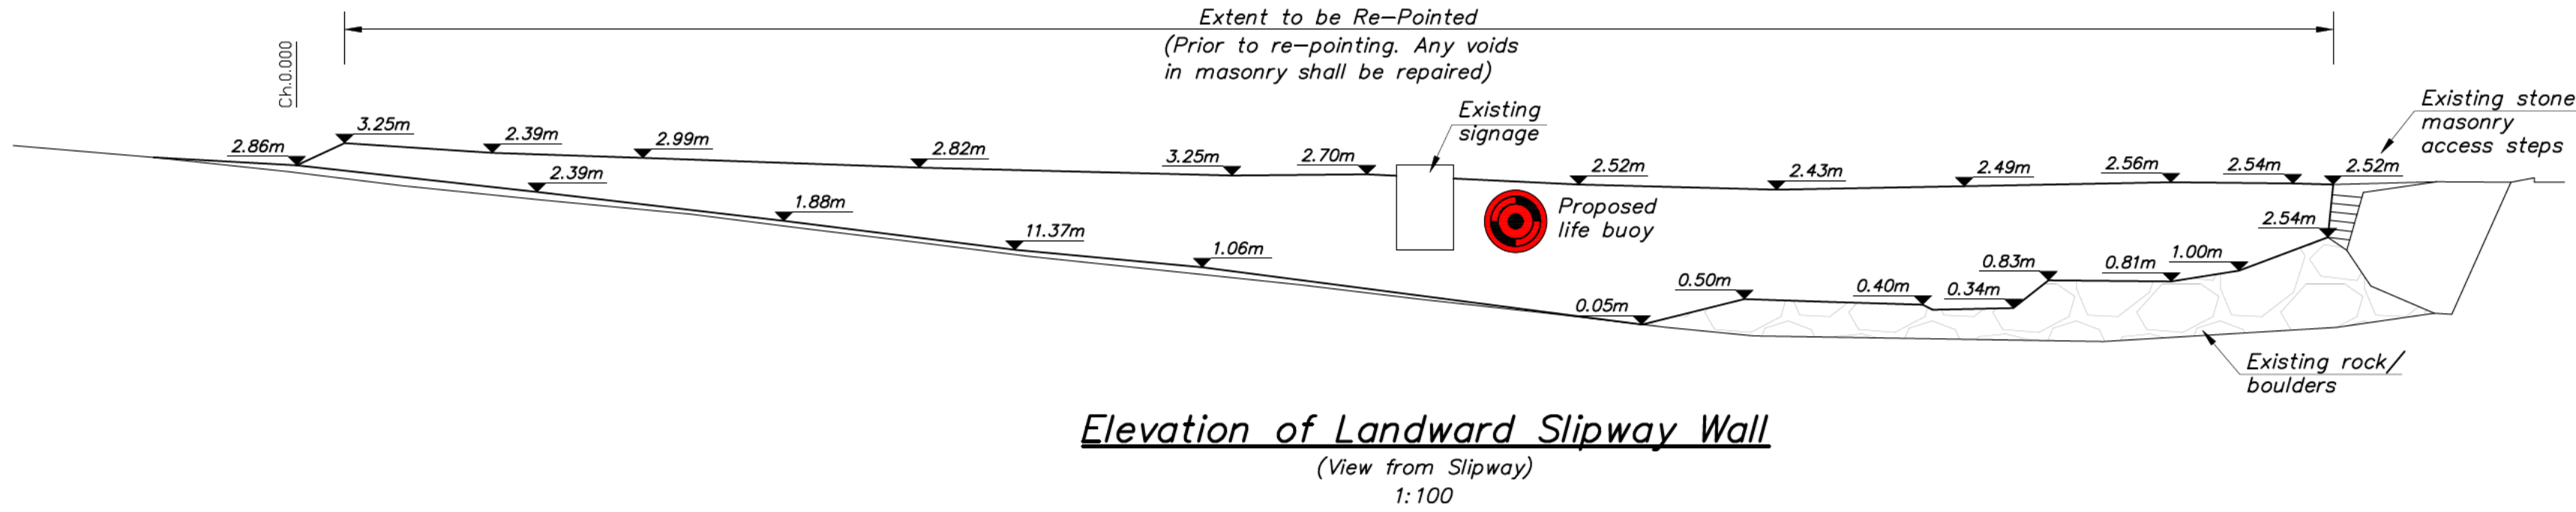

Joints Up to 50mm in Depth
Typical Detail
1:10

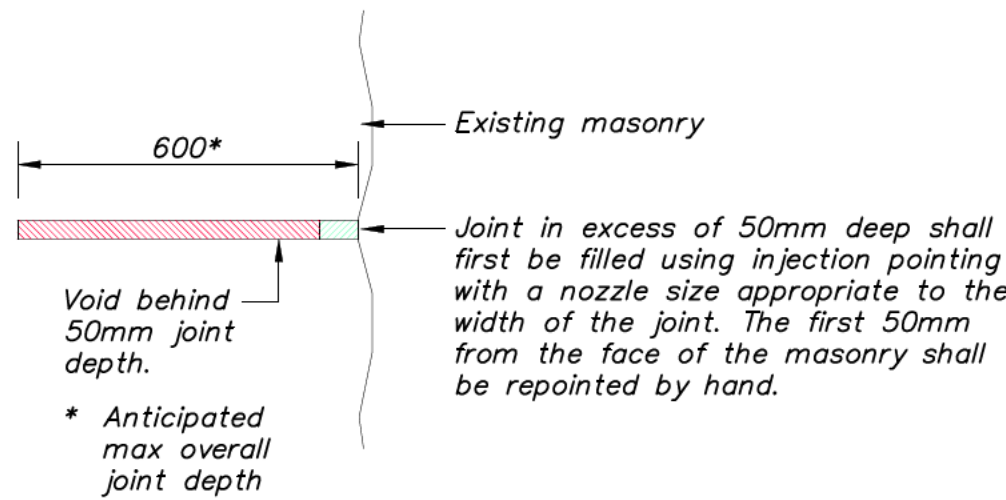


Joints Greater Than 50mm in Depth
Typical Detail
1:10

Re-Pointing Notes

1. Masonry shall be cleaned and marine growth shall be removed prior to re-pointing. All re-pointing shall be carried out using lime mortar.
2. For areas above MHWS not subjected to wetting during curing, lime mortar shall comprise NHL 5.0 Lime binder with a 2:5 Lime:Sand mix ratio.
3. For areas below MHWS subject to wetting during curing, lime mortar shall comprise NHL 5.0 with 10% addition of Prompt natural hydraulic binder.
4. Sand used for lime mortar shall conform to BS EN 13139.

Masonry Repair Notes


1. Voids shall be cleaned out and all marine growth and loose stone/pebbles removed.
2. Old embedded timbers shall be removed prior to repairs.
3. Voids shall be filled with concrete and finished with stone facing to match existing masonry.
4. Concrete shall be Grade C40/50 with 0.45 maximum water cement ratio and minimum 360kg/m3 cement content.

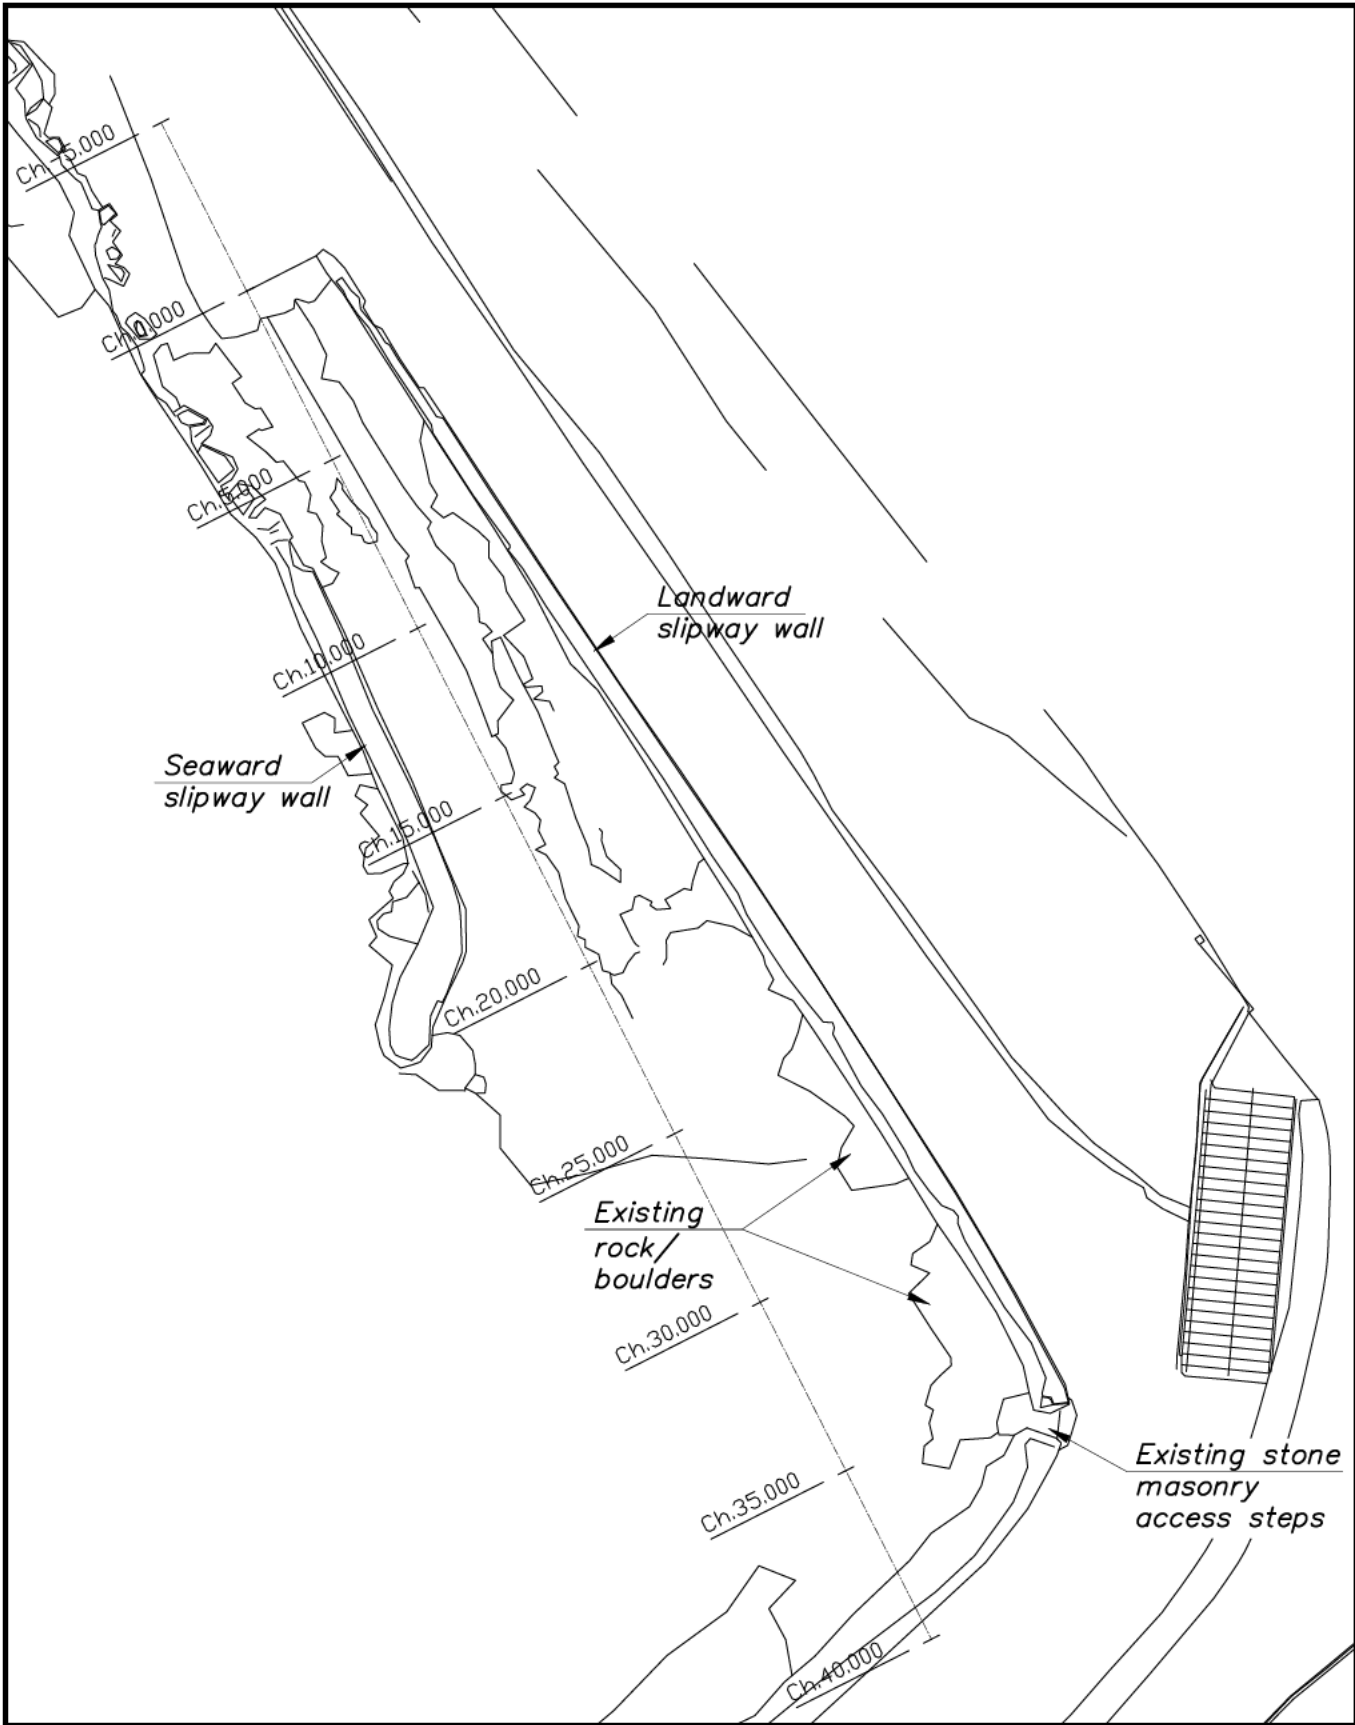

Key Plan
1:200

Tide Level Notes:

1. All levels in metres to Ordnance Datum (OD) unless otherwise noted.
2. All dimensions in mm unless noted otherwise.
3. Ordnance datum (OD) at Portrush Harbour is 1.24m above Chart Datum (CD).

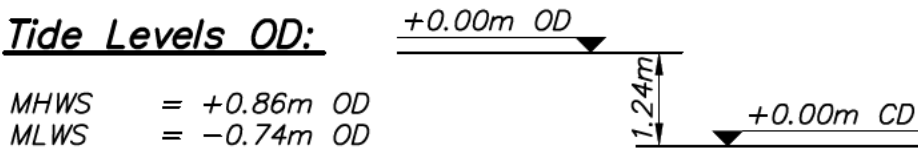

PRELIMINARY DRAWING

Project Title:
**OLD SLIPWAY
PORTRUSH HARBOUR**

Drawing Title:
MASONRY WALL REPAIRS

Client: CC&GBC	Drawn by: ■	Date: July 2026
Project Number: -	Checked by: ■	Scales: 1:100
Doran Project Number: 221063C	Approved by: ■	Sheet Size: A1 Uniclass: PM_40_40
Drawing Number: 221063C-DCL-MCL-XX-D-C-0301	Revision: P01	STATUS: S4



Photograph 1



Photograph 2



Photograph 3



Photograph 4