

CONSENT NO: 1353/24/1

FILE NO: TC 069/24

DEPARTMENT OF AGRICULTURE, ENVIRONMENT AND RURAL AFFAIRS

Water (Northern Ireland) Order 1999

Consent to Discharge of Effluent

TO: NWP Enviro Limited
32 Glenside Road
Dunmurry
Co. Antrim
BT17 0LH

The Department of Agriculture, Environment and Rural Affairs in pursuance of the powers conferred on it by the Water (Northern Ireland) Order 1999 HEREBY CONSENTS to your making a discharge into the Waterway at Irish Grid Reference J 0475 4465 in accordance with the application dated 23rd May 2024 in respect of a discharge of Site Drainage from Lisbane Integrated Waste Management Facility situated at 29 Aughlish Road, Tandragee, Co. Armagh, BT62 2EE.

SUBJECT TO the following conditions:

1. The effluent discharged to the waterway shall not:
 - a. contain suspended solids in excess of 50 milligrams per litre (measured after drying at 105⁰C);
 - b. have a biochemical oxygen demand in excess of 10 milligrams per litre (measured after 5 days at 20°C with nitrification suppressed by the addition of allyl-thiourea);
 - c. contain any visible oil or grease;
 - d. contain any substance (other than as defined above) which will cause the waterway or water in an underground stratum to be toxic or injurious to fish or other aquatic organisms;

CONSENT NO: 1353/24/1

FILE NO: TC 069/24

DEPARTMENT OF AGRICULTURE, ENVIRONMENT AND RURAL AFFAIRS

Water (Northern Ireland) Order 1999

Consent to Discharge of Effluent

- e. contain any substance (other than as defined above) to such an extent as to cause the receiving waters, or any waters of which the receiving waters are a tributary, to be poisonous or injurious to the spawning grounds, spawn or food of fish in those waters, or otherwise cause damage to the ecology of those waters.
2. Facilities shall be available to ensure that a representative sample of the discharge can be obtained. The sampling point shall be at the location shown on the site plan attached.
3. The sample point for this discharge shall be labelled and maintained at grid reference J04754465, so that it is freely available and accessible to authorised officers of the Department.
4. The treatment system shall be maintained to ensure that consent conditions are met at all times.
5. Authorised officers of the Department shall be allowed to readily and safely obtain a sample of the effluent, measurement of flow, images of discharge or other data relative to the discharge at all times.
6. Under the requirements of the Control of Pollution (Oil Storage) Regulations (Northern Ireland) 2010 all oil storage must comply with the appropriate requirements as laid out in the regulations. Oil in the regulations is defined as “any kind of oil, including diesel, heating, waste, vegetable and plant oil”. The only exemptions to the regulations are: (a) any property used mainly as a private dwelling if the storage capacity is 3500 litres or less, (b) any storage below 200 litres, (c) any storage on a farm if the storage is used in connection with agriculture, (d) any premises regulated by COMAH or (e) any container wholly underground.
7. Bunds shall be provided around all chemical storage tanks to reduce the risk of pollution of waterways and groundwater from spillage or leakage.

CONSENT NO: 1353/24/1

FILE NO: TC 069/24

DEPARTMENT OF AGRICULTURE, ENVIRONMENT AND RURAL AFFAIRS

Water (Northern Ireland) Order 1999

Consent to Discharge of Effluent

8. The storage of any chemicals or dangerous substances not listed on the original consent application shall be notified immediately to the Department.
9. Any change of process, or introduction of new process chemicals not specified on the original consent application shall be notified immediately to the Department.
10. The discharge shall not cause any visible change to any part of the waterway either at the discharge point or at any point downstream.
11. The person making the discharge shall be responsible for payment of all annual charges.
12. Should the consent holder wish to transfer responsibility for this consent they must submit an application for transfer of ownership within 21 days of the transfer taking place.
13. If the consent holder intends to change anything at the site which will impact on the content of this consent and/or the composition or quality of the effluent then they must make application to the Department for review of this consent. Review application should be made no later than 4 months before the proposed changes will be carried out.

INFORMATIVE

1. This discharge consent may be reviewed at any time, if the area of discharge or any area downstream, has been, or becomes designated under the European Communities Nature Conservation (Natural Habitats etc) Regulations (Northern Ireland) 1995 or the consent conditions do not meet the requirements of any other European Community Directive.

CONSENT NO: 1353/24/1

FILE NO: TC 069/24

DEPARTMENT OF AGRICULTURE, ENVIRONMENT AND RURAL AFFAIRS


Water (Northern Ireland) Order 1999

Consent to Discharge of Effluent

2. It is an offence under section 47 of the Fisheries Act (Northern Ireland) 1966 to cause pollution which is subsequently shown to have a deleterious effect on fish stocks.
3. In the catchment areas for both Lough Foyle and Carlingford Lough it is an offence under section 41 of the Foyle Fisheries Act (1952) to cause pollution which is detrimental to fisheries interests.
4. This consent does not grant the right of access to or use of third party land for the installation and/or maintenance of any of the treatment and drainage infrastructure to which this consent relates. It is the responsibility of the consent holder to obtain any third party way-leave or access permission required.

Dated this 21st day of August 2024

***Northern Ireland Environment Agency
Water Regulation Team
17 Antrim Road
Lisburn
Co. Antrim
BT28 3AL***


.....

AUTHORISED OFFICER


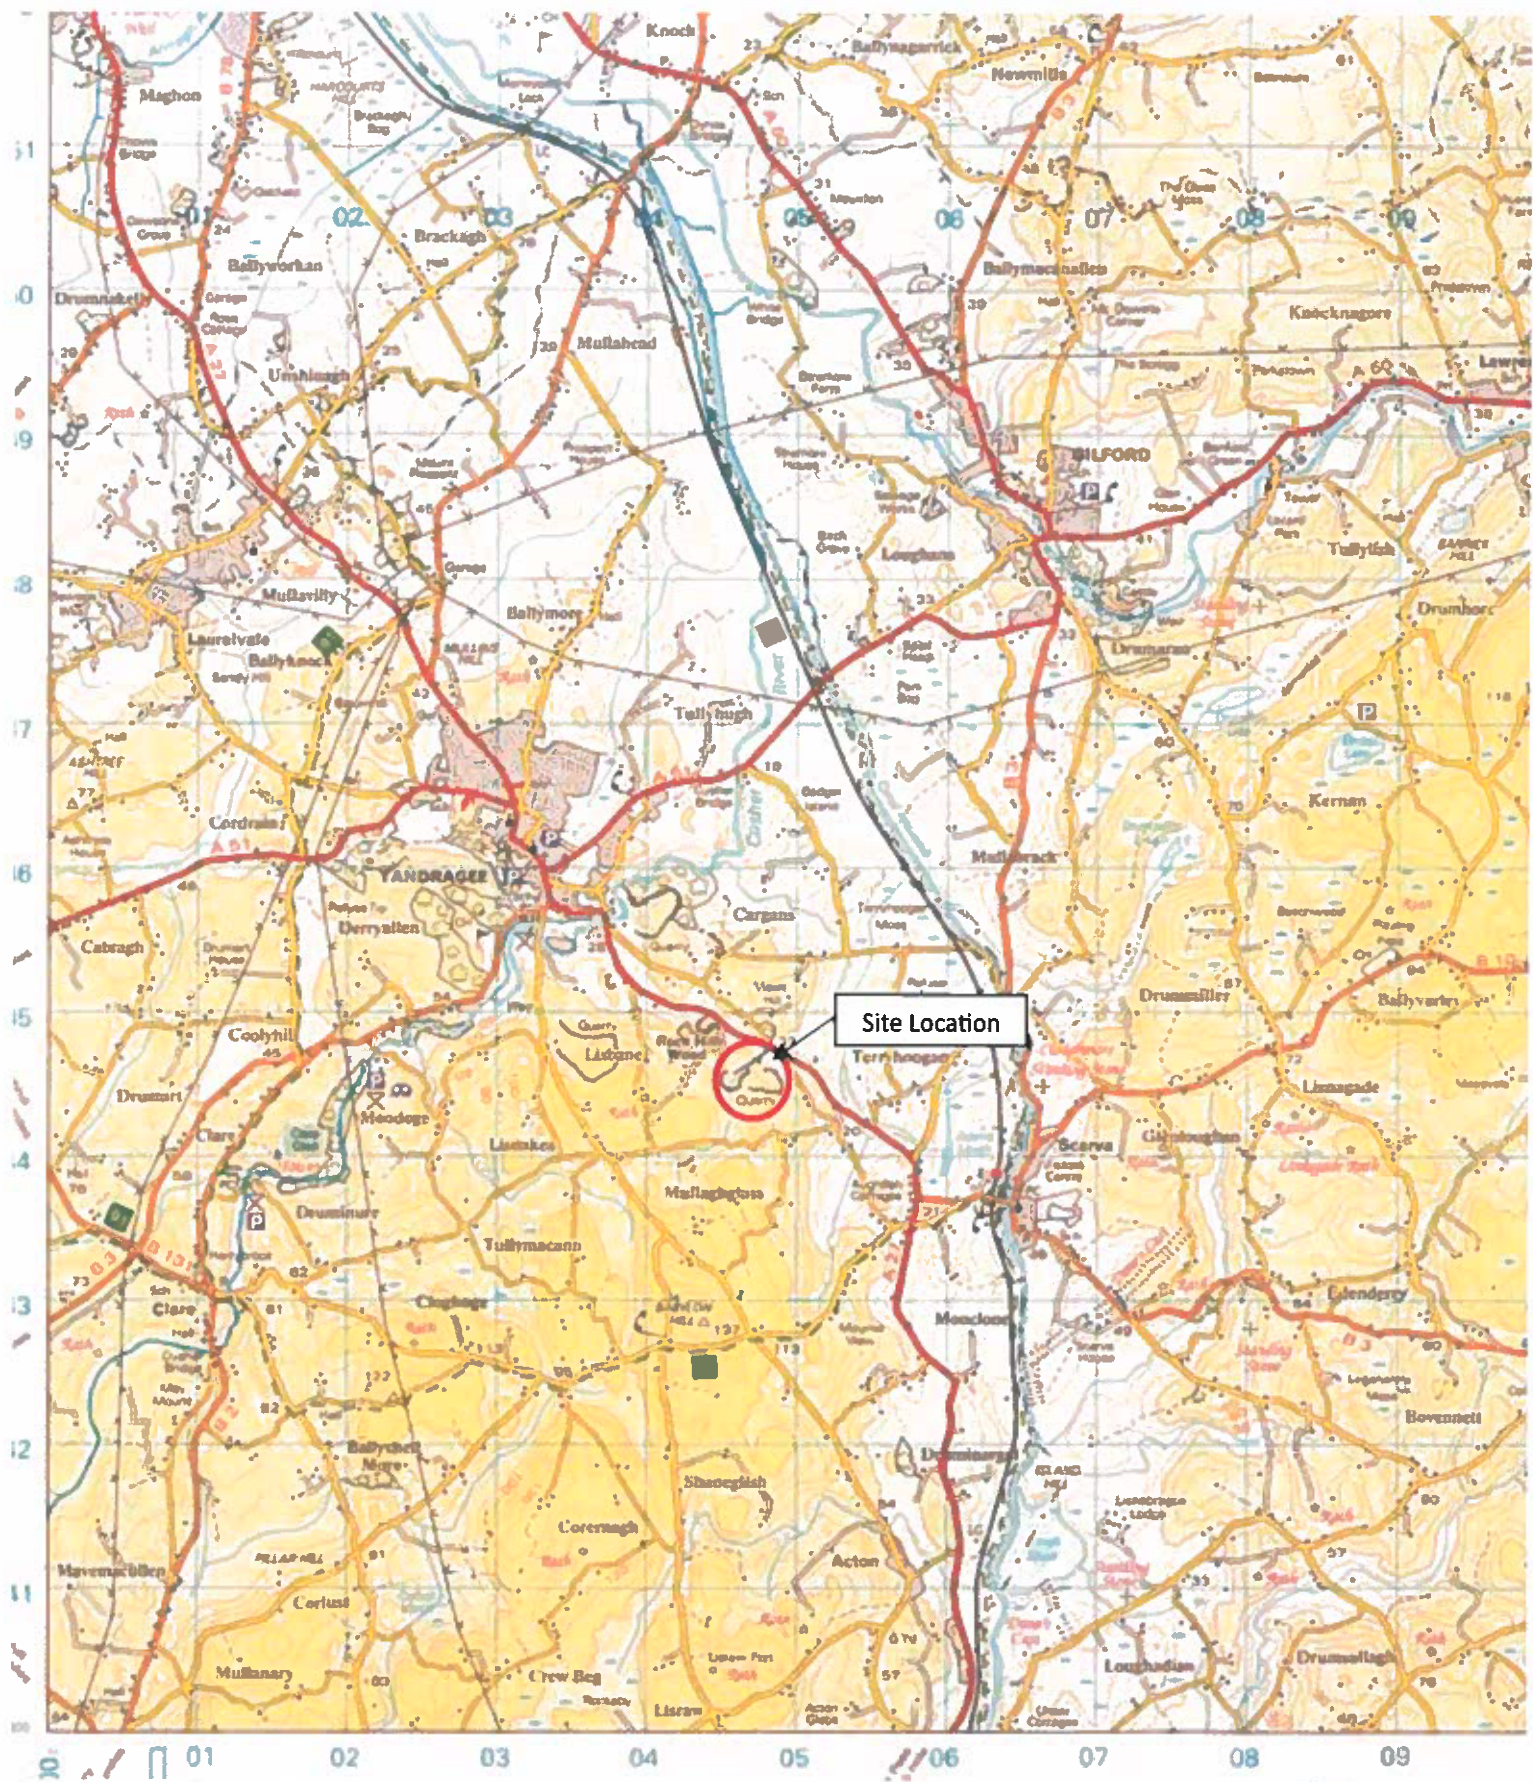


Figure 1



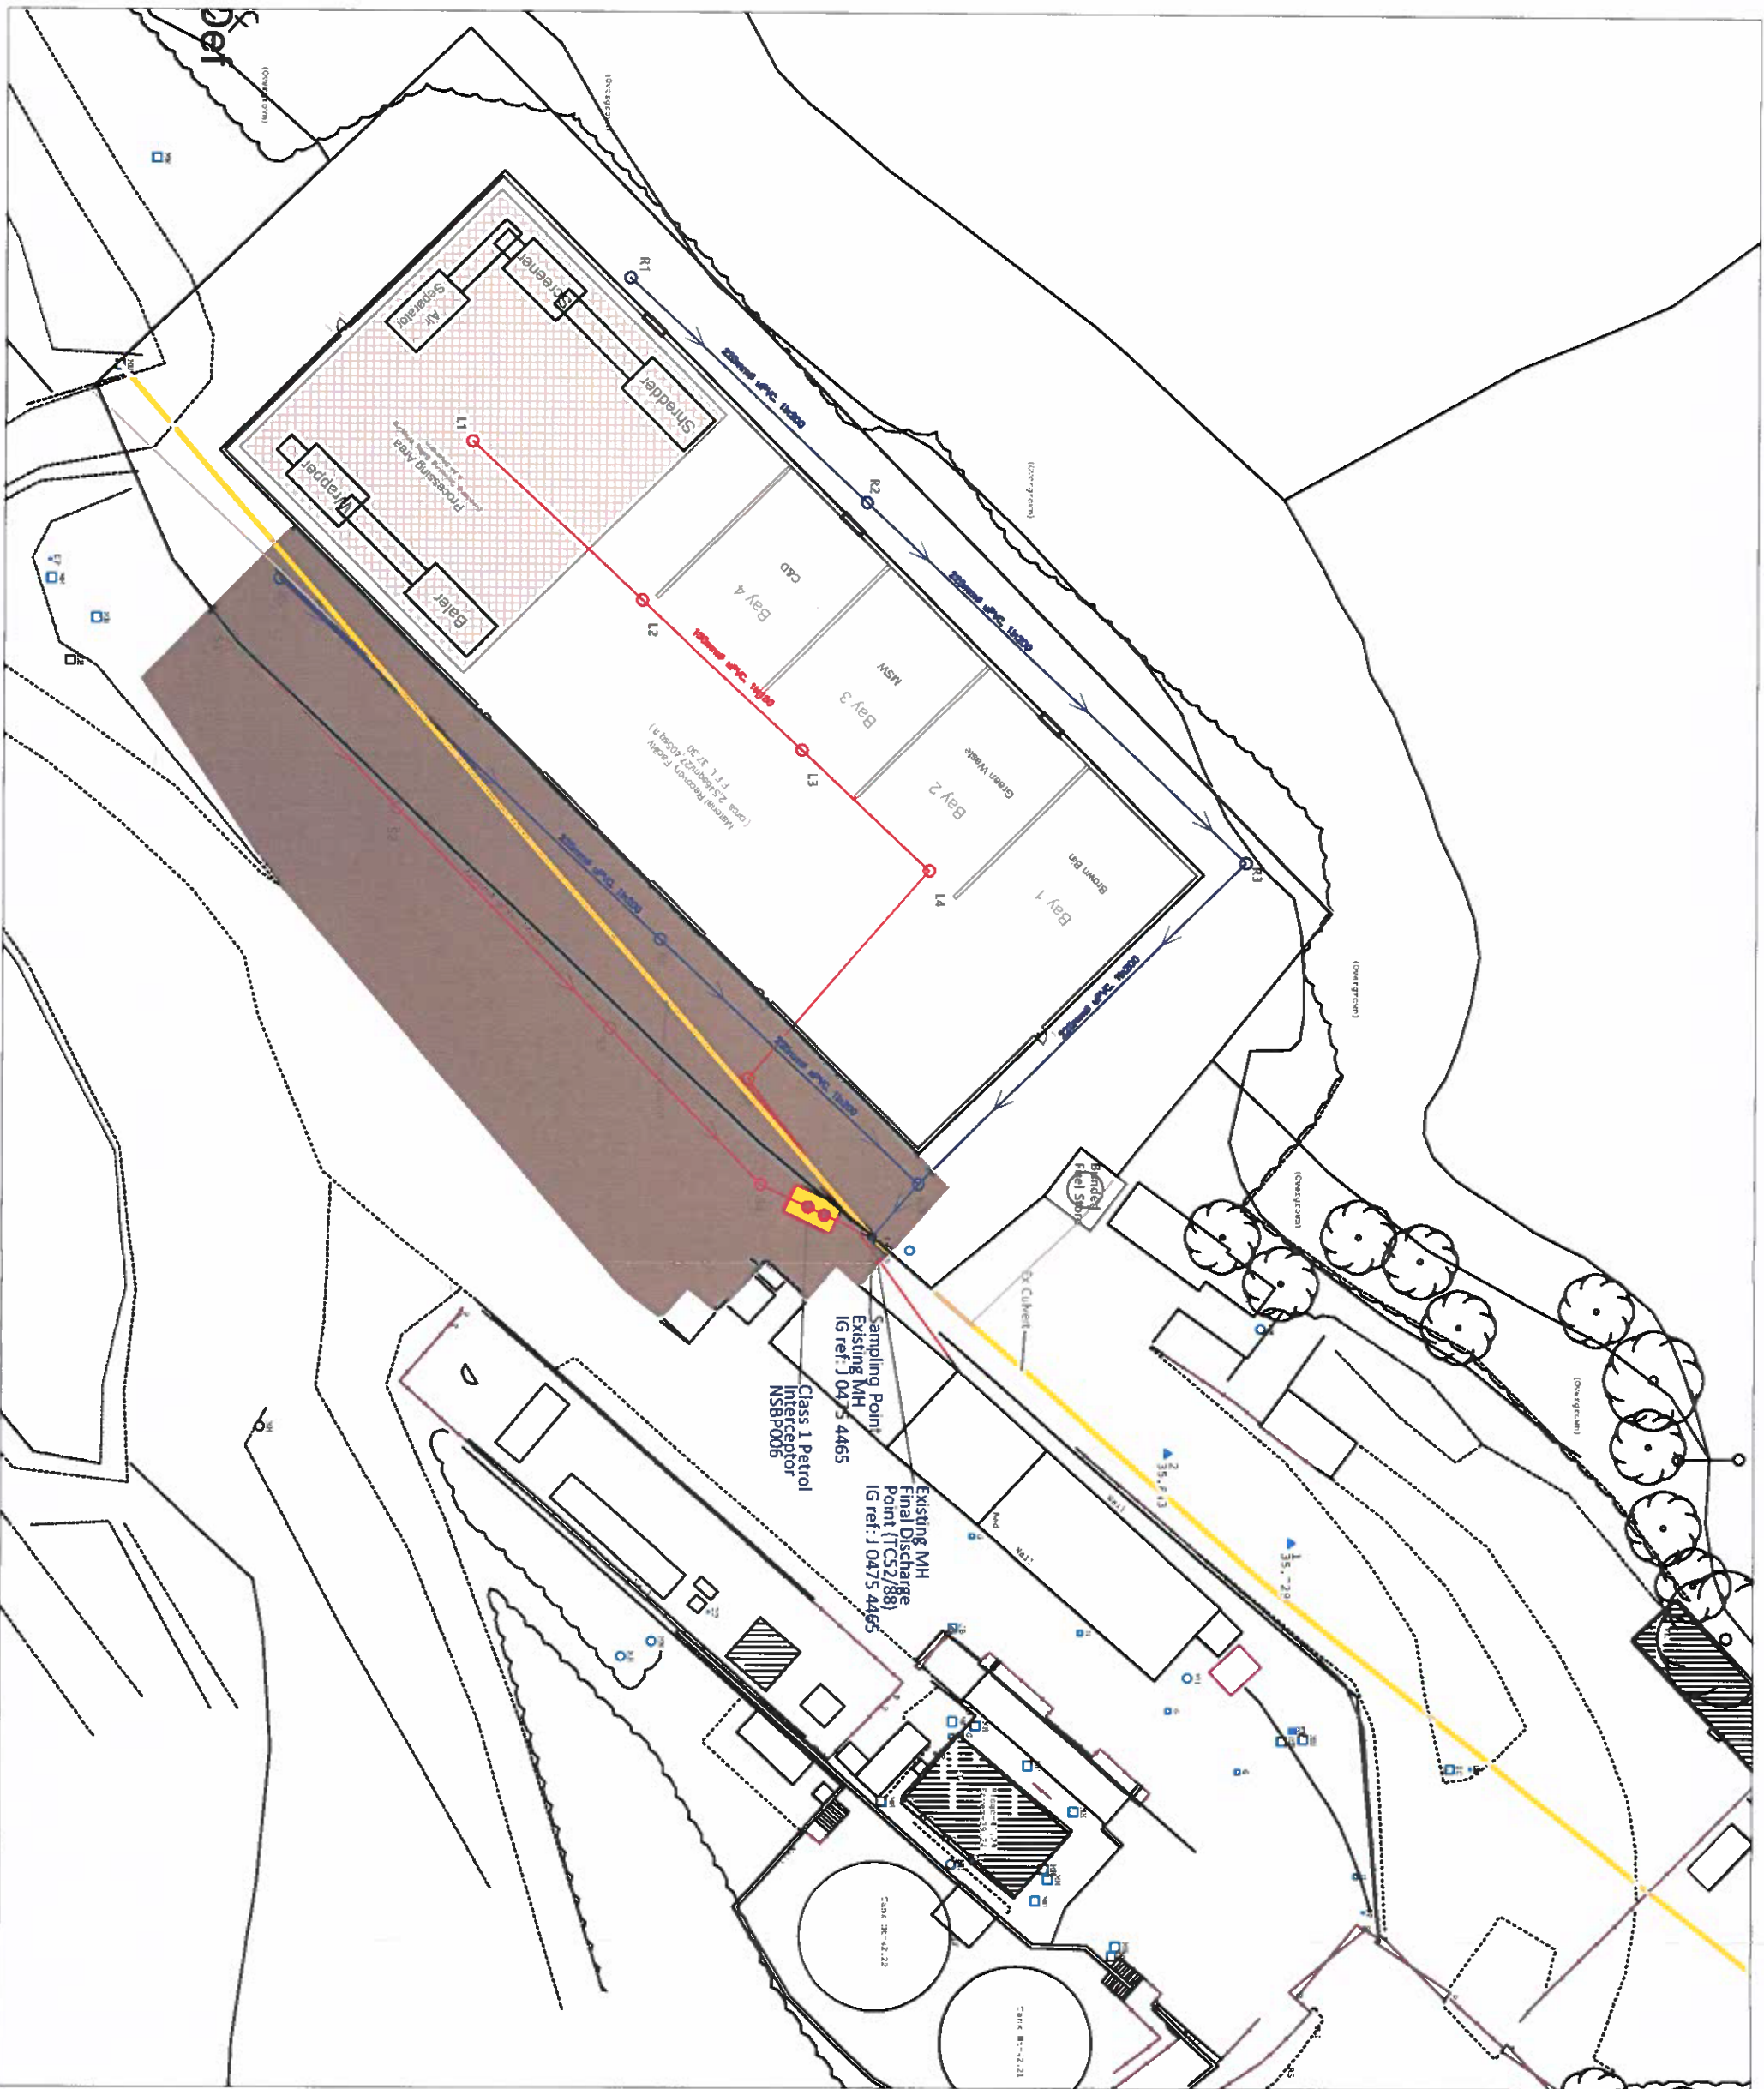

Notes:

Class 1 Petrol Interceptor to be provided for all storm water run off from concrete hard standing area
Discharge Consent for Storm Water - (CS2/88)

Pipeline Key:


- Proposed Roof Water Drainage
- Proposed Storm Sewer
- Proposed Leachate Drainage
- Existing Culvert

NWP Enviro LTD

Aughlish Road, Tandragee,

Fig.2
Proposed Site Drainage

Scale 1:500 Date 28/05/24

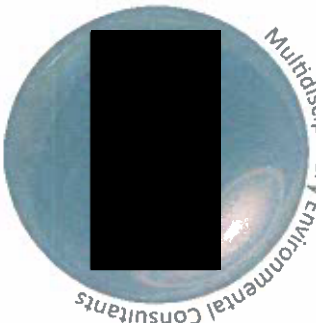

Tel: [REDACTED]

CONSENT NO: 820/88/2

FILE NO: TC 52/87_2

DEPARTMENT OF AGRICULTURE, ENVIRONMENT AND RURAL AFFAIRS

Water (Northern Ireland) Order 1999

Consent to Discharge of Effluent (Review)

TO: Verdant Restoration Ltd
32 Glenside Road
Dunmurry
Co. Antrim
BT19 0LH

The Department of Agriculture, Environment and Rural Affairs in pursuance of the powers conferred on it by the Water (Northern Ireland) Order 1999 HEREBY CONSENTS to your making a discharge into the Waterway at Irish Grid Reference J 04833 44734 in accordance with the original application dated 12 April 1988 and the current review request dated 8 December 2025 in respect of a discharge of site drainage arising from premises situated at 29 Aughlish Road, Tandragee, Craigavon, Co. Armagh, BT62 2EE.

SUBJECT TO the following conditions:

1. The effluent discharged to the waterway shall not:
 - (a) Contain suspended solids in excess of 50 milligrams per litre.
 - (b) Contain any visible oil or grease.
 - (c) Contain any substance (other than as defined above) which will cause the waterway to be toxic or injurious to fish or other aquatic organisms.
2. Facilities shall be available for sampling the final effluent.

CONSENT NO: 820/88/2

FILE NO: TC 52/87_2

DEPARTMENT OF AGRICULTURE, ENVIRONMENT AND RURAL AFFAIRS

Water (Northern Ireland) Order 1999

Consent to Discharge of Effluent (Review)

3. The sampling point shall be at the end of the 9" pipe as shown on the site plan.

Dated this 29th day of December 2025

***Northern Ireland Environment Agency
Water Regulation Team
17 Antrim Road
Lisburn
Co Antrim
BT28 3AL***



.....

AUTHORISED OFFICER


to Tardagee

Cargans townland

of Housing, Local Govt. & Planning
PLANNING (NI) ORDER 1972

GRANTED: SUBJECT TO
CONDITIONS (IF ANY) AS SET OUT IN
DECISION FORM NO. 01472/75

SATED

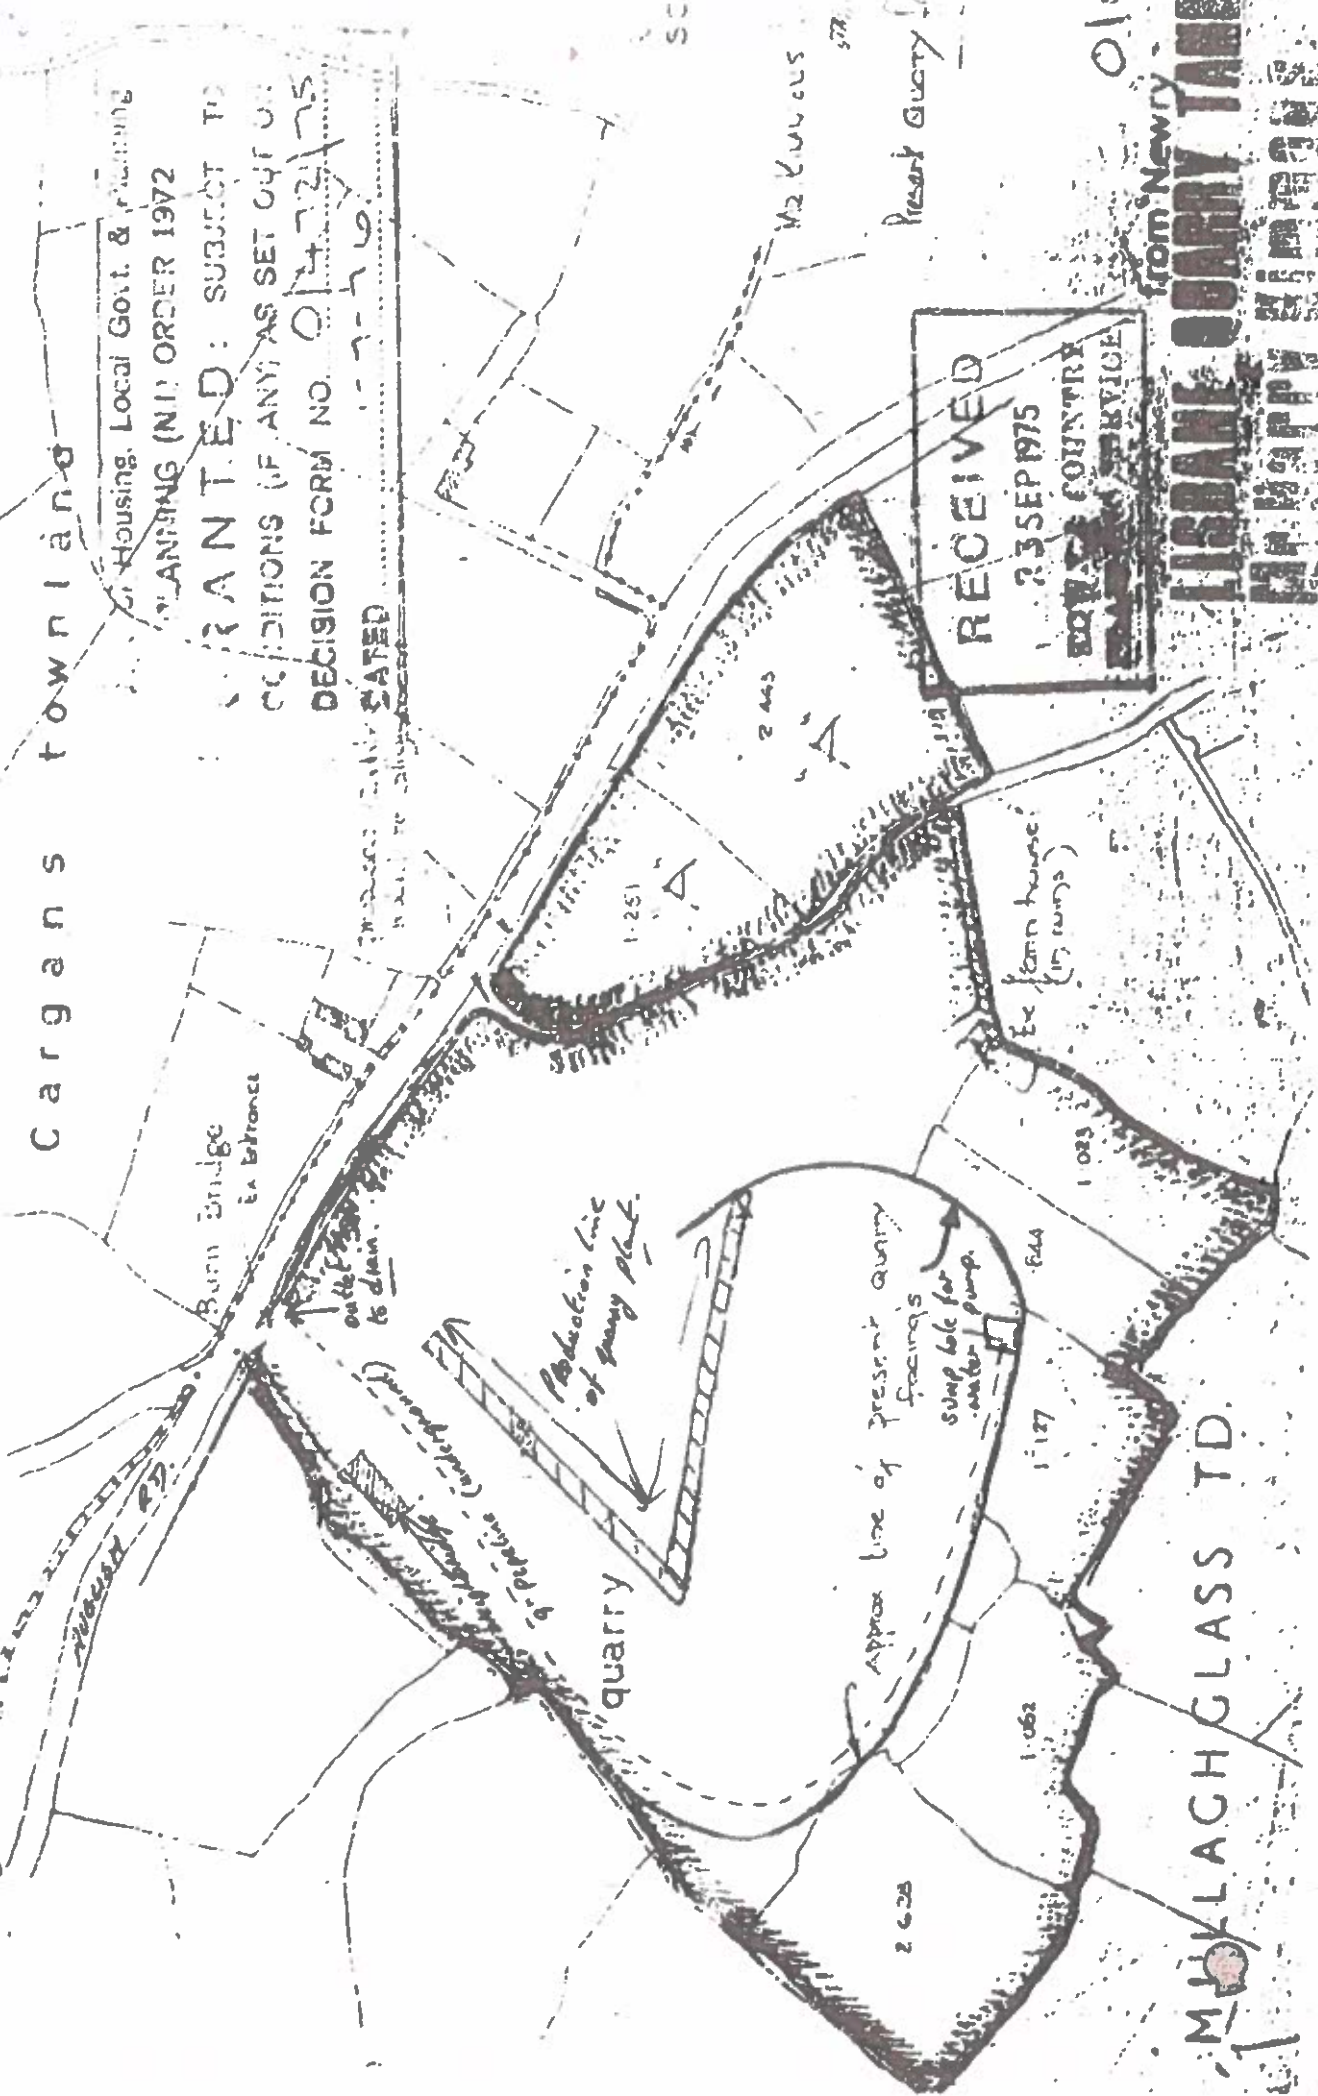

MOLLAHLACH GLASS TD

from Newry

RECEIVED
23 SEP 1975
ROYAL COUNTRY SERVICE

014